


NOTES:

1. AN INDIVIDUAL METERED SERVICE MAY BE SUPPLIED FOR EACH BUILDING STRUCTURE WHICH STANDS ALONE OR WHICH HAS READILY DEFINABLE AREAS SEPARATED BY PARTITIONS HAVING AN APPROVED FIRE RATING.
2. THE CUSTOMER MUST PROVIDE UNRESTRICTED ACCESS TO METERING AND MAY BE REQUIRED TO PURCHASE A HORIZON UTILITIES CORP. KEY BOX TO BE INSTALLED ON SITE.
3. SPLITTER TROUGH COVER SHALL BE HINGED TO OPEN DOWNWARD AND EQUIPPED WITH PROVISION FOR PADLOCK AND SEAL.
4. A FULL-SIZED NEUTRAL SUPPLY CONDUCTOR SHALL BE EXTENDED FROM THE SPLITTER TROUGH AND CONNECTED TO AN INSULATED NEUTRAL TERMINAL INSIDE EACH METER SOCKET WHEN SUPPLY IS 4 WIRE.
5. ELECTRICAL CONTRACTORS SHALL MARK UNIT NUMBERS WITH PERMANENT NUMBERING ACCEPTABLE TO HORIZON UTILITIES CORPORATION ON METER SOCKETS AND ON THE SERVICE BOX INSIDE THE UNITS.

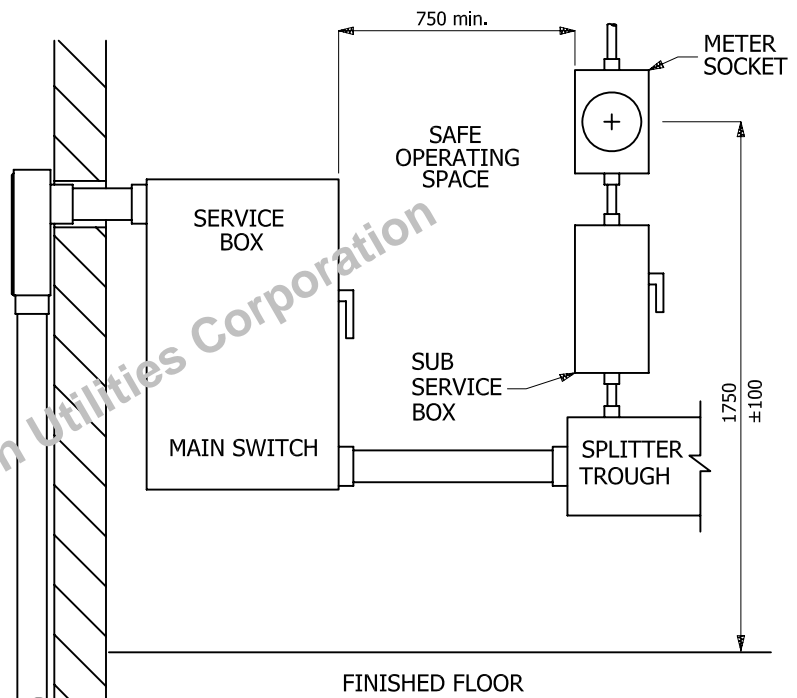

DRAWING STATUS	BY	DATE DD/MM/YY
DRAWN:	JM	28/06/07
CHECKED:	AV	15/09/05
APPROVED:	CR	15/09/05

MULTIPLE SERVICE METERING INSTALLATION COMMERCIAL

200A SUPPLY

LINEAR DIMENSIONS SHOWN IN MILLIMETERS

DRAWINGS NOT TO SCALE

DRAWING #	SHEET #	REVISION #
27-07	1	0

REFERENCE DRAWINGS: