


NOTES:

1. HORIZON UTILITIES CORP. APPROVED METER ENCLOSURE MAY BE PURCHASED FROM HORIZON UTILITIES CORPORATION OR SOME OTHER ELECTRICAL DISTRIBUTORS - REFERENCE HYDEL CATALOGUE NUMBER 74820585 OR HONI SPECIFICATION NUMBER DL27135D09.
2. INSTRUMENT TRANSFORMER ENCLOSURE SHALL BE EQUIPPED WITH:
 - a) HINGED DOORS FULL-HEIGHT OF COMPARTMENT
 - b) PROVISION FOR PADLOCK AND SEAL
 - c) NEUTRAL TAP WITH TWO TERMINALS
 - d) MADE OF 16 OR 14 GAUGE STEEL.
3. THE CUSTOMER SHALL SUBMIT DRAWINGS PRIOR TO START OF MANUFACTURE FOR APPROVAL OF METERING ARRANGEMENT AND SPECIFICATION OF CURRENT TRANSFORMERS SUPPLIED BY HORIZON UTILITIES CORPORATION FOR INSTALLATION AT THE FACTORY.
4. A DEDICATED PHONE LINE IN CONDUIT SHALL BE INSTALLED AND MAINTAINED BY THE CUSTOMER FROM THE DEMARCATION POINT IN THE BUILDING TO THE INSIDE OF THE METER ENCLOSURE. A COMMUNICATION AGREEMENT MUST BE COMPLETED & SIGNED BY CUSTOMER
5. THE CUSTOMER MUST PROVIDE UNRESTRICTED ACCESS TO THE METERING AND MAY BE REQUIRED TO PURCHASE A HORIZON UTILITIES CORP. KEY BOX TO BE INSTALLED ON SITE.
6. FOR MULTIPLE METERS THE UNIT MUST BE PERMANENTLY MARKED ON METER BASE, CONNECTED SERVICE PANEL AND SERVICE DISCONNECT.



LEFT-SIDE SECTION

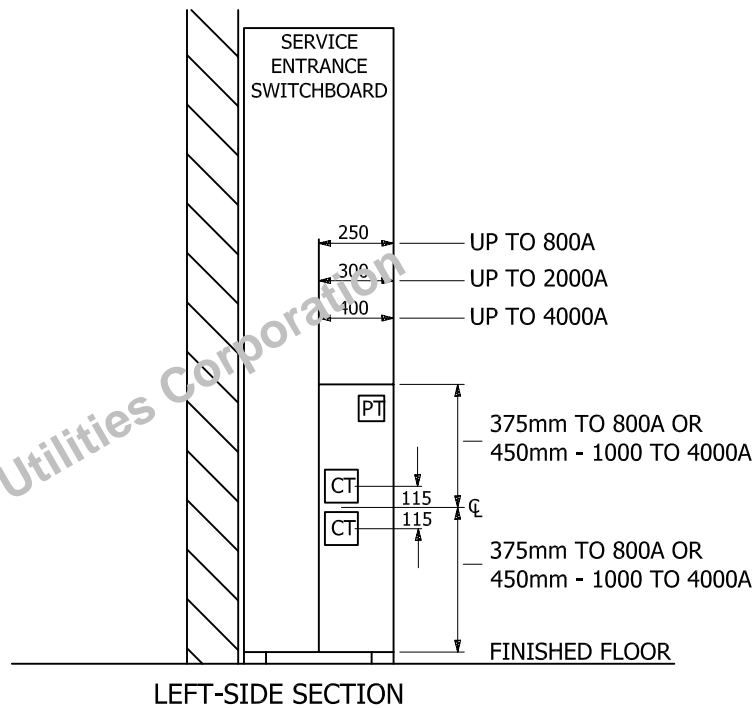

DRAWING STATUS	BY	DATE DD/MM/YY
DRAWN:	JM	27/06/07
CHECKED:	AV	15/09/05
APPROVED:	CR	15/09/05

**TRANSFORMER-TYPE SWITCHBOARD
METERING-3PHASE**

800A-4000A 347/600V OR 2000A-4000A 120/208V
LINEAR DIMENSIONS SHOWN IN MILLIMETERS

DRAWINGS
NOT TO SCALE

REFERENCE DRAWINGS:

DRAWING #	SHEET#	REVISION#
27-11	1	0