


NOTES:

1. AN INDIVIDUAL METERED SERVICE MAY BE SUPPLIED FOR EACH BUILDING STRUCTURE WHICH STANDS ALONE OR WHICH HAS READILY DEFINABLE AREAS SEPARATED BY PARTITIONS HAVING AN APPROVED FIRE RATING.
2. METERS SHALL BE INSTALLED IN A CENTRAL SERVICE ROOM WHICH HAS DIRECT OUTSIDE ACCESS OR COMMON ACCESS TO ALL METERED BUILDING STRUCTURES.
3. FOR BUILDINGS THAT EXCEED FOUR FLOORS, METER CENTRES WILL BE PERMITTED ON EVERY THIRD FLOOR.
4. A KEY DEPOSIT BOX PURCHASED FROM HORIZON UTILITIES CORP., SHALL BE INSTALLED OUTSIDE THE ACCESS DOOR TO THE CENTRAL SERVICE ROOM.
5. EACH METER SOCKET SHALL BE PROTECTED BY A CIRCUIT BREAKER CONNECTED ON THE SUPPLY SIDE OF THE SOCKET.
6. INDIVIDUAL UNIT #'S MUST BE PERMANENTLY MARKED ON METER BASE, CONNECTED SERVICE PANEL AND SERVICE DISCONNECT (IF NOT LOCATED BESIDE METER).
7. THE CUSTOMER MUST PROVIDE UNRESTRICTED ACCESS TO METERING.

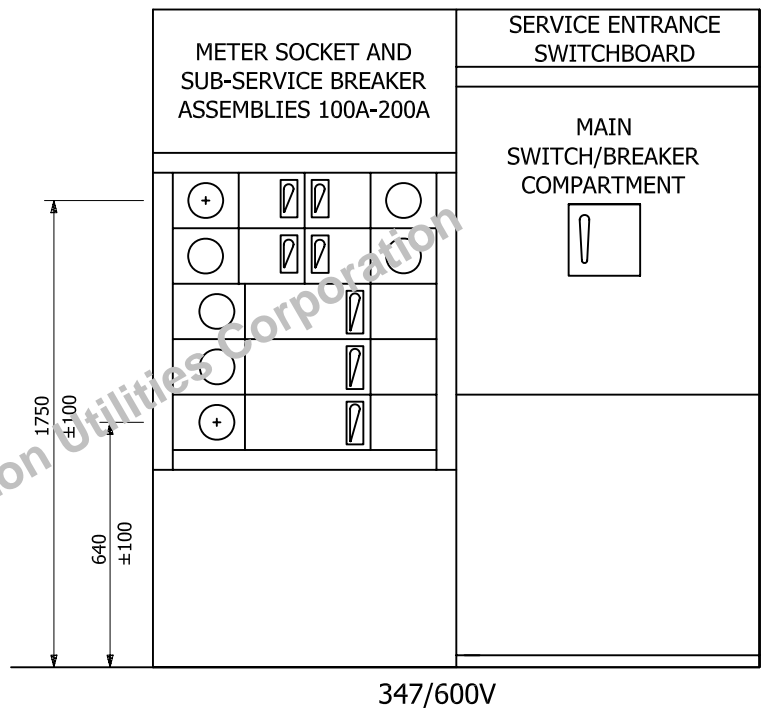

DRAWING STATUS	BY	DATE DD/MM/YY
DRAWN:	JM	27/06/07
CHECKED:	AV	15/09/05
APPROVED:	CR	15/09/05

MULTIPLE SERVICE SWITCHBOARD/METER-CENTER
400A-400A SUPPLY
LINEAR DIMENSIONS SHOWN IN MILLIMETERS

DRAWINGS NOT TO SCALE

REFERENCE DRAWINGS:

DRAWING #	SHEET #	REVISION #
27-13	1	0